

LEGEND

- M MANUAL PULL STATION
- H HEAT DETECTOR
- S SMOKE DETECTOR
- D DUCT DETECTOR
- C CARBON MONOXIDE DETECTOR
- FAP FIRE ALARM PANEL
- DSD DUAL STROBES AND SPEAKER
- L LOCAL OPERATING CONSOLE
- W WEATHER RATED DUAL STROBES AND SPEAKER
- PDS PHOTOGRAPHIC SMOKE DETECTOR
- T TEXT SIGN
- F FLOW SWITCH
- T TAMPER SWITCH
- FAM FIRE ALARM ANNUNCIATOR
- DAP DVC PANEL
- M MONITOR MODULE

1
EXISTING FIRE ALARM SYSTEM

NO SCALE

KEYED NOTES:


1 THIS AREA IS NOT TO SCALE AND IS REFERENCING DEVICE LAYOUT ONLY

EXISTING FIRE ALARM SYSTEM

**DIRECTORATE
OF PUBLIC WORKS
FORT MOORE, GEORGIA**

**REPLACE FIRE ALARM SYSTEM
BUILDING 9230
FORT MOORE, GEORGIA**

SYMBOL	DATE	BY
REVISIONS		
DRAWN BY R. MCCAIN APPROVED J.C. VANLAND DATE NO.		
DRAWING NUMBER 44473-E1		SCALE NOTED DATE 05 FEB 24

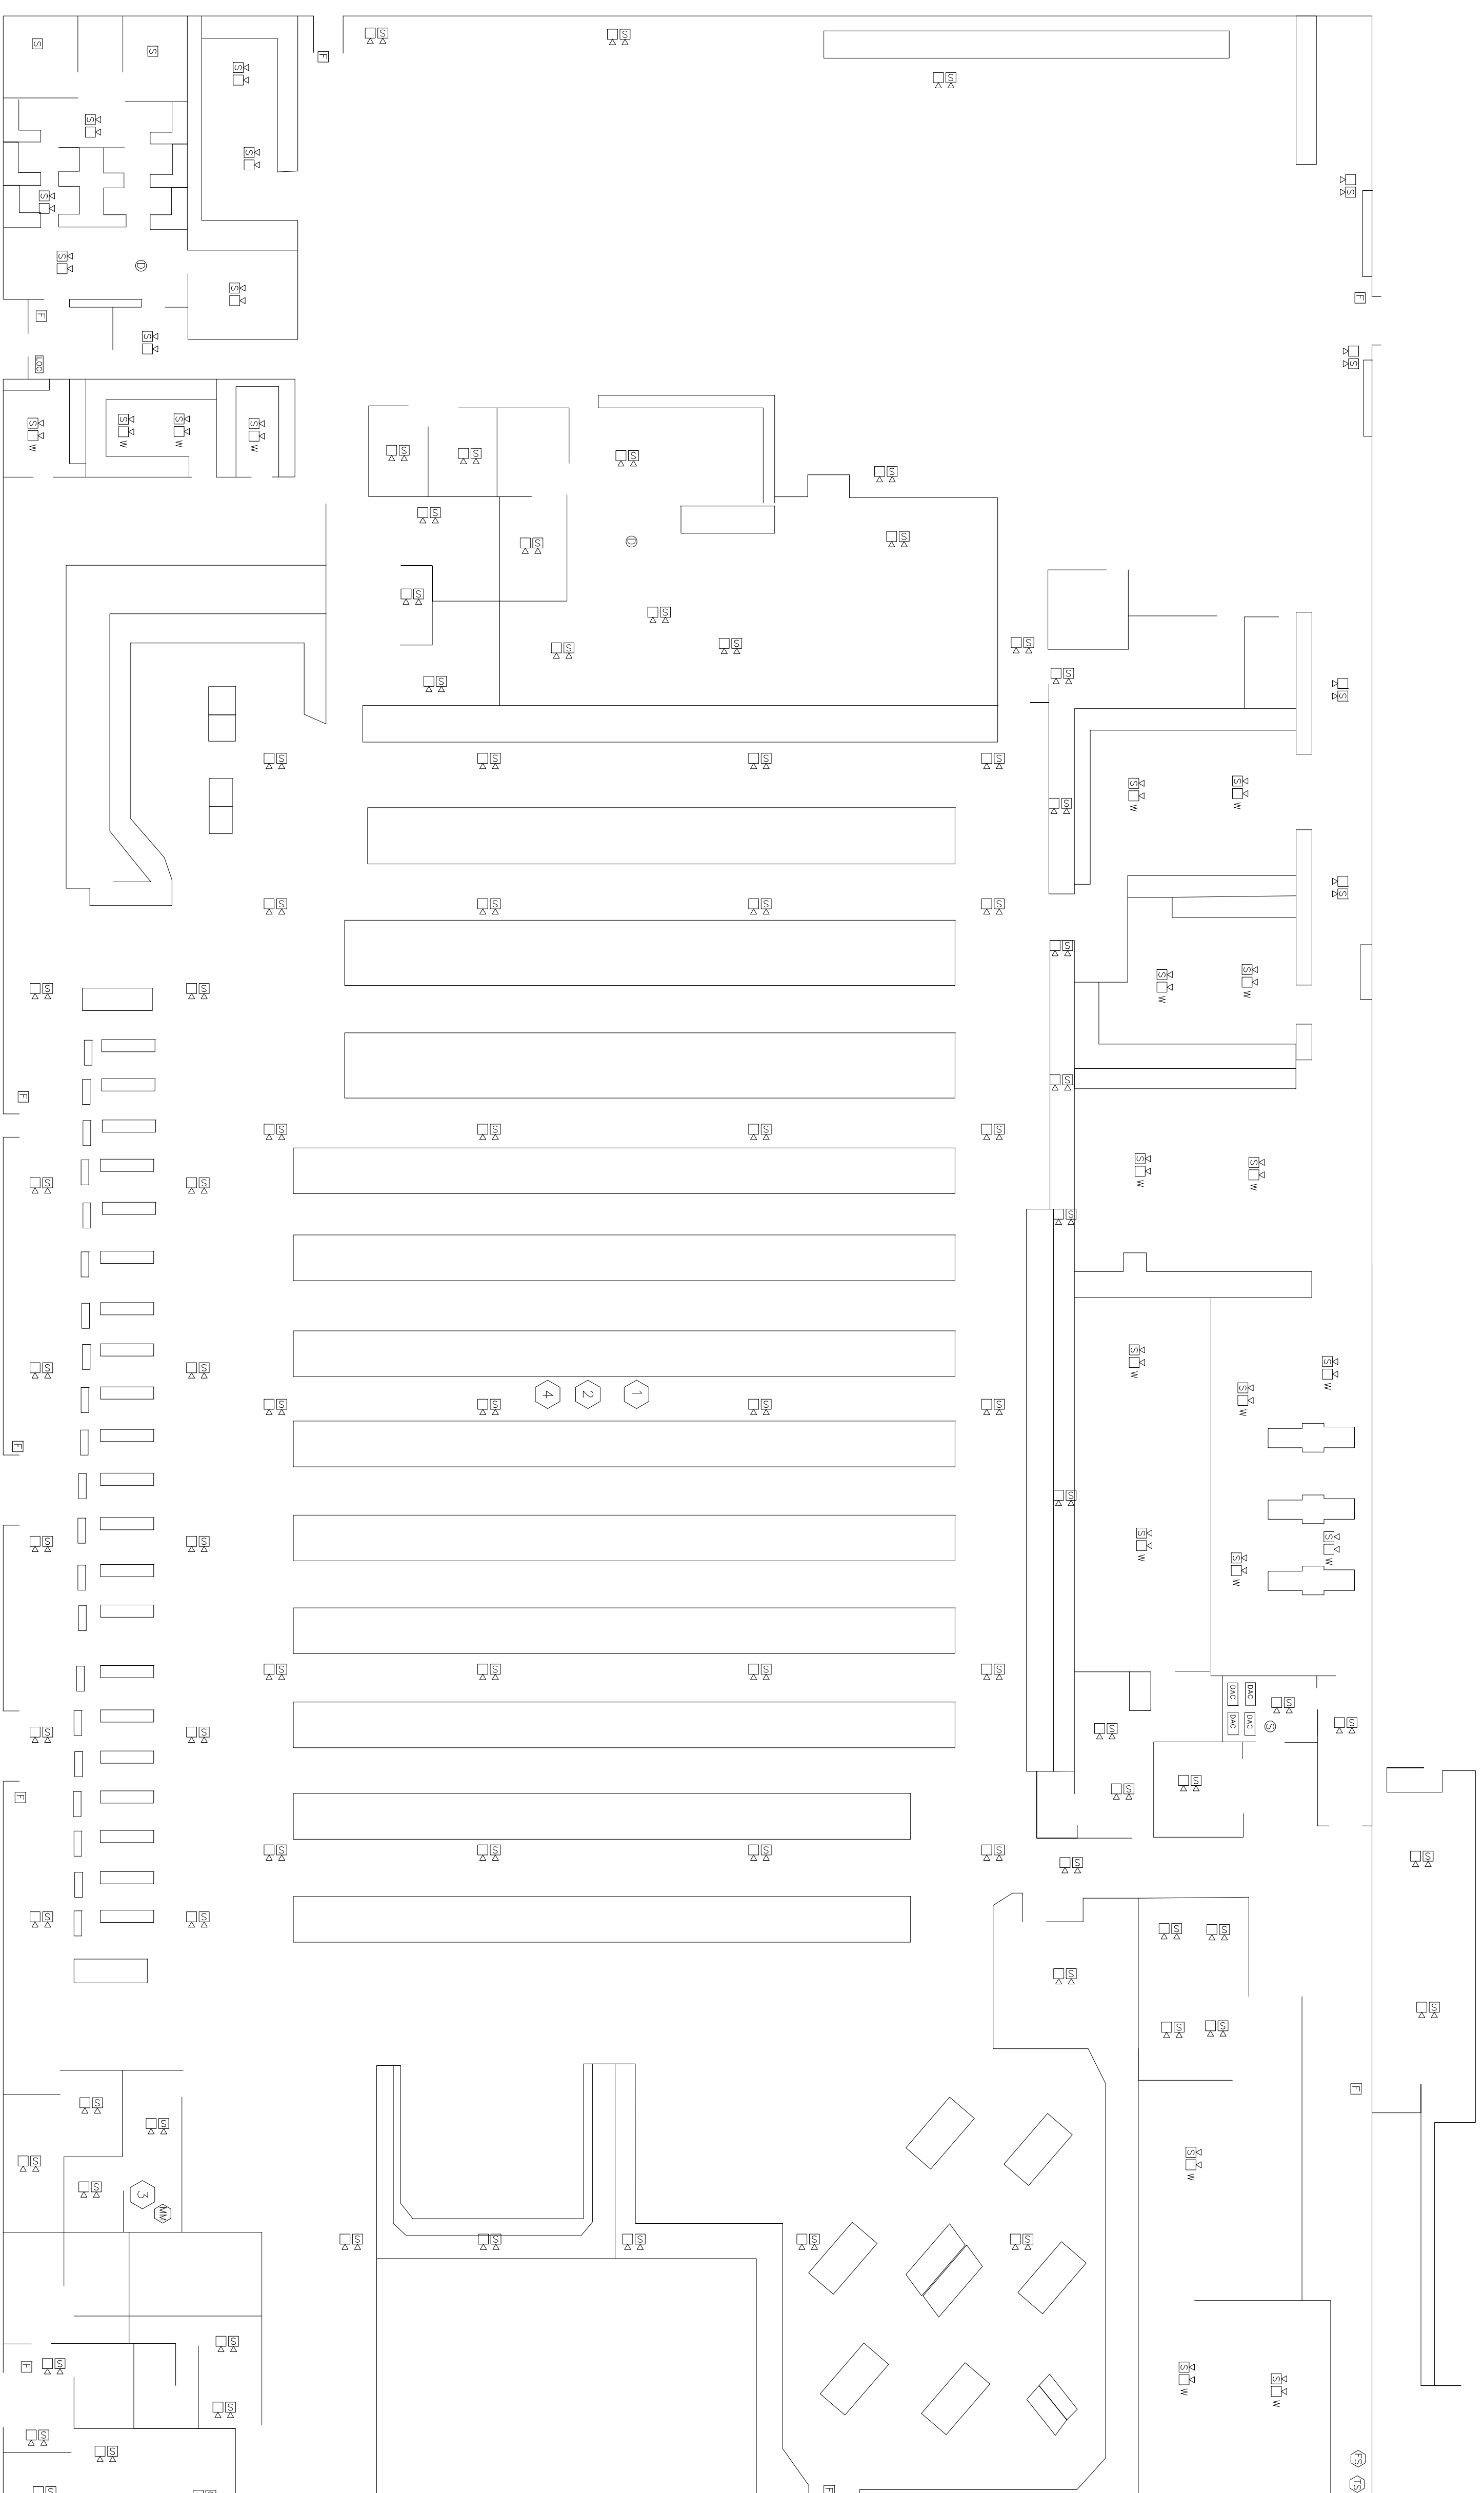

KEYED NOTES:

- 1 CAREFUL COORDINATION WITH USER OF COMMISSARY SIDE IS REQUIRED DUE TO COMMISSARY REMAINING OPERATIONAL.
- 2 ALL DEMO AND NEW WORK INSIDE THE SHOPPING AREAS SHALL BE DONE AT COORDINATED TIMES WITH USER TO REDUCE IMPEDING OPERATIONS OF THE COMMISSARY.
- 3 THE LOCAL PA SYSTEM IS BYPASSED DURING GENERAL ALARM AND MNS ACTIVATION THROUGH A RELAY MODULE.
- 4 THIS ENTIRE AREA IS NOT TO SCALE AND IS REFERENCING DEVICE LAYOUT ONLY.

LEGEND

- ☐ MANUAL PULL STATION
- ⊕ HEAT DETECTOR
- ⊙ SMOKE DETECTOR
- ⊖ DUCT DETECTOR
- ⊗ GASEOUS MONITOR
- ⊘ FIBER OPTIC
- ⊙ FIRE ALARM PANEL
- ⊗ DUAL STROBES AND SPEAKER
- ⊞ LOCAL OPERATING CONSOLE
- ⊞ w WEATHER RATED DUAL STROBES AND SPEAKER
- ⊙ PHOTOELECTRIC SMOKE DETECTOR
- ⊞ TEXT SIGN
- ⊞ FLOW SWITCH
- ⊞ TAMPER SWITCH
- ⊞ FIRE ALARM ANNUNCIATOR
- ⊞ DAC PANEL
- ⊞ MONITOR MODULE

1
E2

COMMISSARY EXISTING FIRE ALARM SYSTEM

NO SCALE

EXISTING FIRE ALARM SYSTEM

**DIRECTORATE
OF PUBLIC WORKS
FORT MOORE, GEORGIA**

REPLACE FIRE ALARM SYSTEM
BUILDING 9230
FORT MOORE, GEORGIA

SYMBOL	DATE	BY
REVISIONS		
DRAWN BY R. MCCAIN	DATE	BY
APPROVED J.C. VANLAND	DATE	BY
DRAWING NUMBER 44473-E2	SCALE NOTED	
DATE 05 FEB 24		

E2